


ASPHALTIC CONCRETE

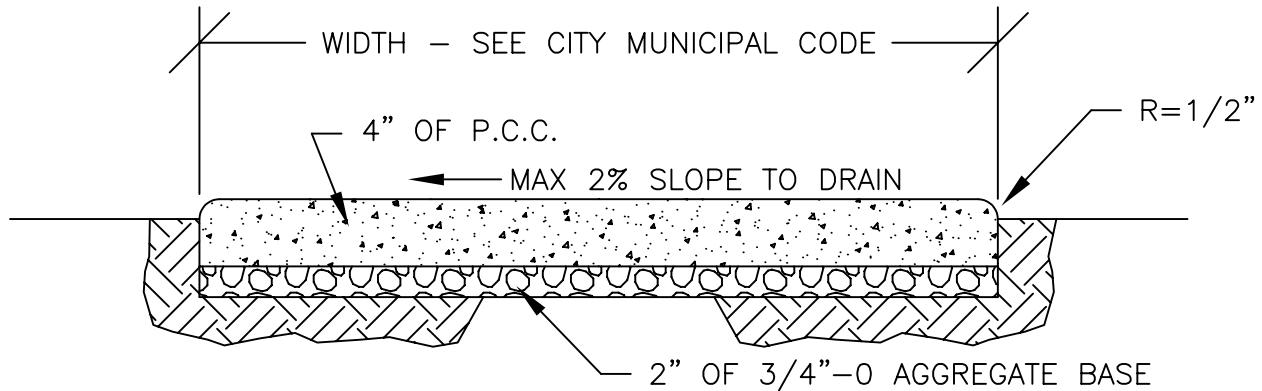

PORTLAND CEMENT CONCRETE

NOTES:

1. CONCRETE SHALL BE AIR ENTRAINED MINIMUM 4.0% AND HAVE A MINIMUM BREAKING STRENGTH OF 4000 PSI AT 28 DAYS.
2. SEE SIDEWALK DETAIL FOR ADDITIONAL NOTES ON CONCRETE CONSTRUCTION.
3. PROVIDE DRAINAGE AT LOW POINTS, AS DIRECTED.
4. PROVIDE ONE FOOT 3/4"-0 GRAVEL SHOULDER ON CUT/FILL SLOPE EDGES.
5. MAXIMUM SLOPE OF CUT AND FILL EDGES, 3:1.
6. SUBGRADE AND BASE ROCK SHALL BE COMPAKTED TO 95% RELATIVE DENSITY PER AASHTO T-99 FOR CONCRETE AND 95% COMPAKTION FOR ACP.
7. SEE CITY MUNICIPAL CODE FOR CROSS SECTION AND ADDITIONAL INFORMATION.



Public Works Standard Drawings

PEDESTRIAN PATH OR BIKEWAY

SCALE NTS	
DATE JUL '25	REV. 1
ENGR. DW	DRAWN KAE
DRAWING NO. 515	